


TYPICAL METER SET ASSEMBLY CLEARANCE REQUIREMENTS

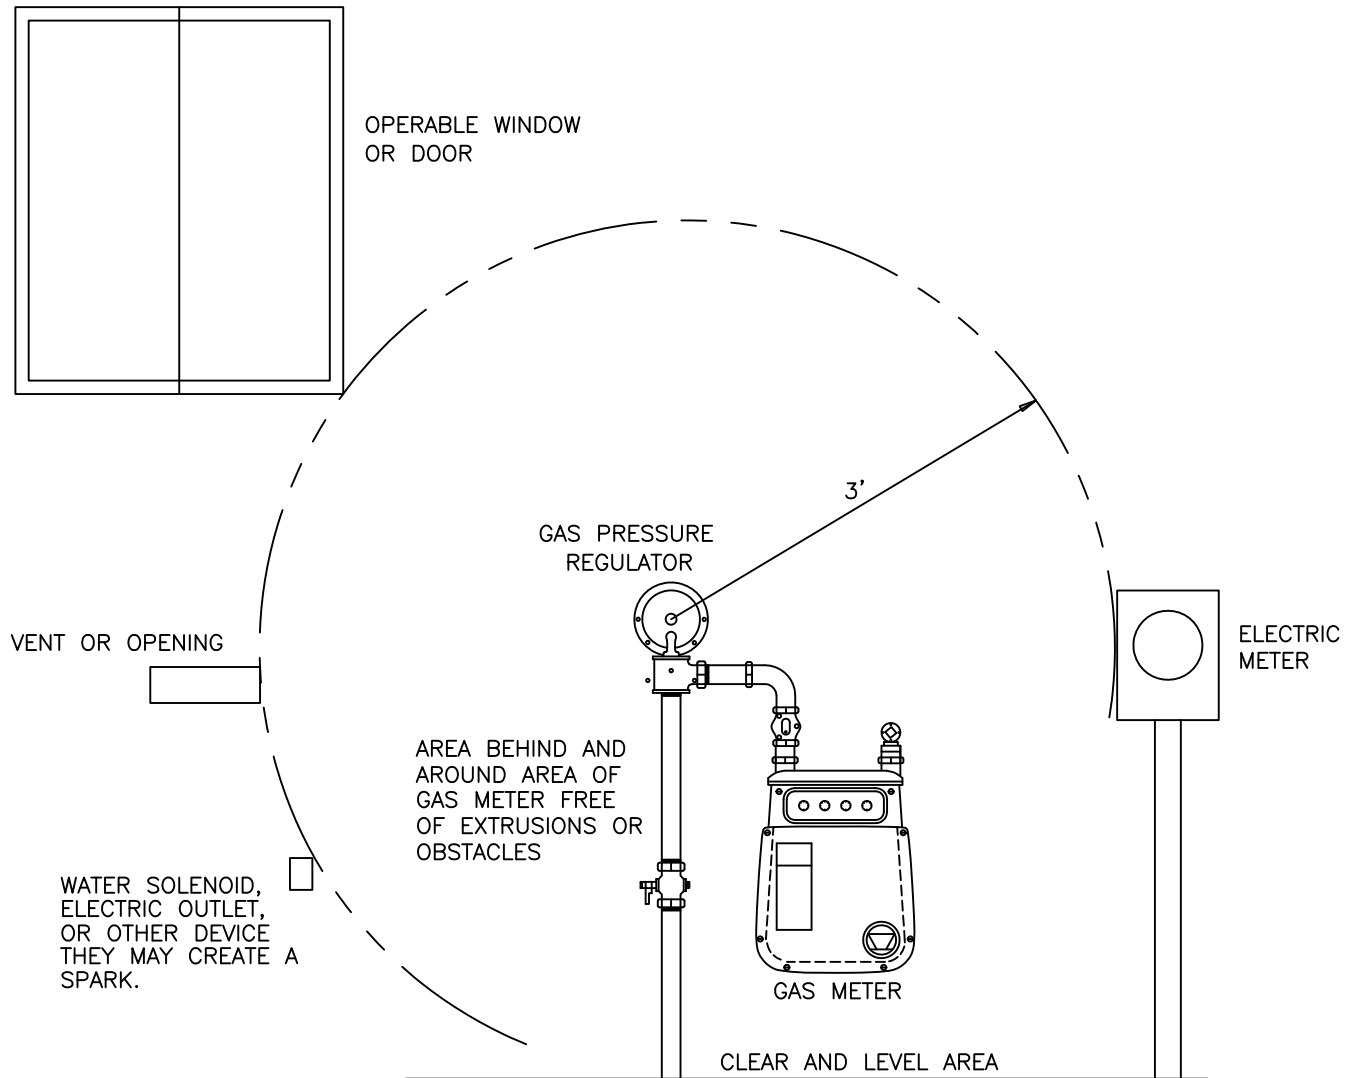

A TYP DETAIL – TYPICAL METER SET ASSEMBLY
NO SCALE

1. THE PREFERRED LOCATION IS ADJACENT TO THE BUILDING TO BE SERVED AND WITHIN 4 FEET OF THE NEAREST FRONT CORNER OF THE BUILDING
2. MSAs SHALL BE IN A LOCATION WHERE DAMAGE FROM VEHICLES IS UNLIKELY. BOLLARDS OR OTHER UES APPROVED SAFE LOCATION MAY BE ALLOWED.
3. A MINIMUM 3-FEET OF CLEAR AND LEVEL WORKING SPACE IS REQUIRED IN FRONT OF THE MSA FOR MAINTENANCE.
4. THE WALL AREA BEHIND THE MSA MUST BE FREED OF ANY OBSTRUCTIONS SUCH AS WATER PIPES, FAUCETS, SEWER CLEAN OUTS, DRAIN SPOUTS, ELECTRICAL CONDUITS, ETC.
5. THE REGULATOR VENT SHALL BE LOCATED A MINIMUM DISTANCE OF 3-FEET FROM THE EDGE OF ANY:
 - SOURCE OF IGNITION SUCH AS ELECTRIC METER, OUTLET OR IRRIGATION SOLENOID
 - OPERABLE WINDOW OR DOOR
 - VENT OR OTHER BUILDING OPENING

UniSource Energy Services Engineering Department	
TYPICAL GAS METER CLEARANCE DETAIL	
DRAWN BY: DCJ	PAGE 1 OF 1
DATE: 2-2017	
SCALE: N.T.S.	